





Enterprise Appliance

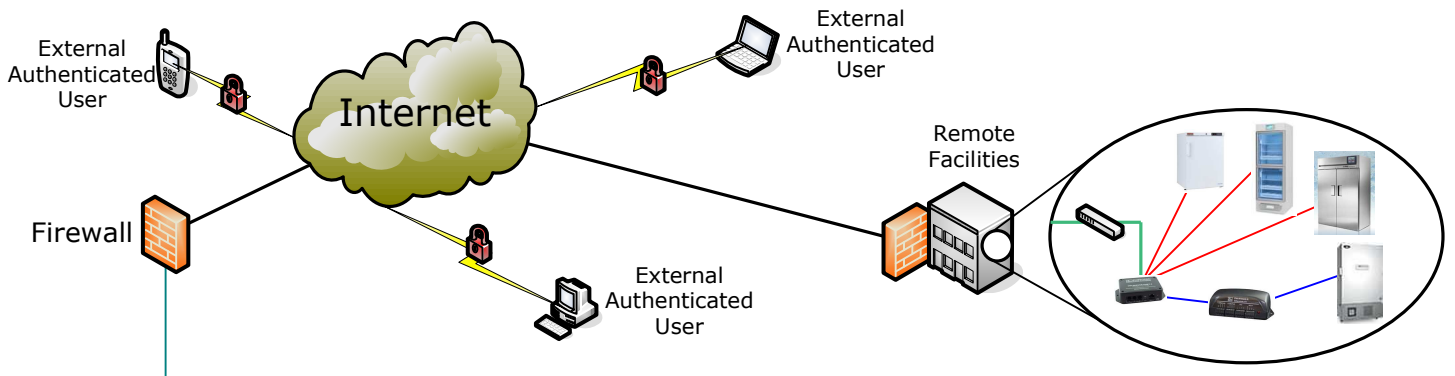

Customer Internal LAN

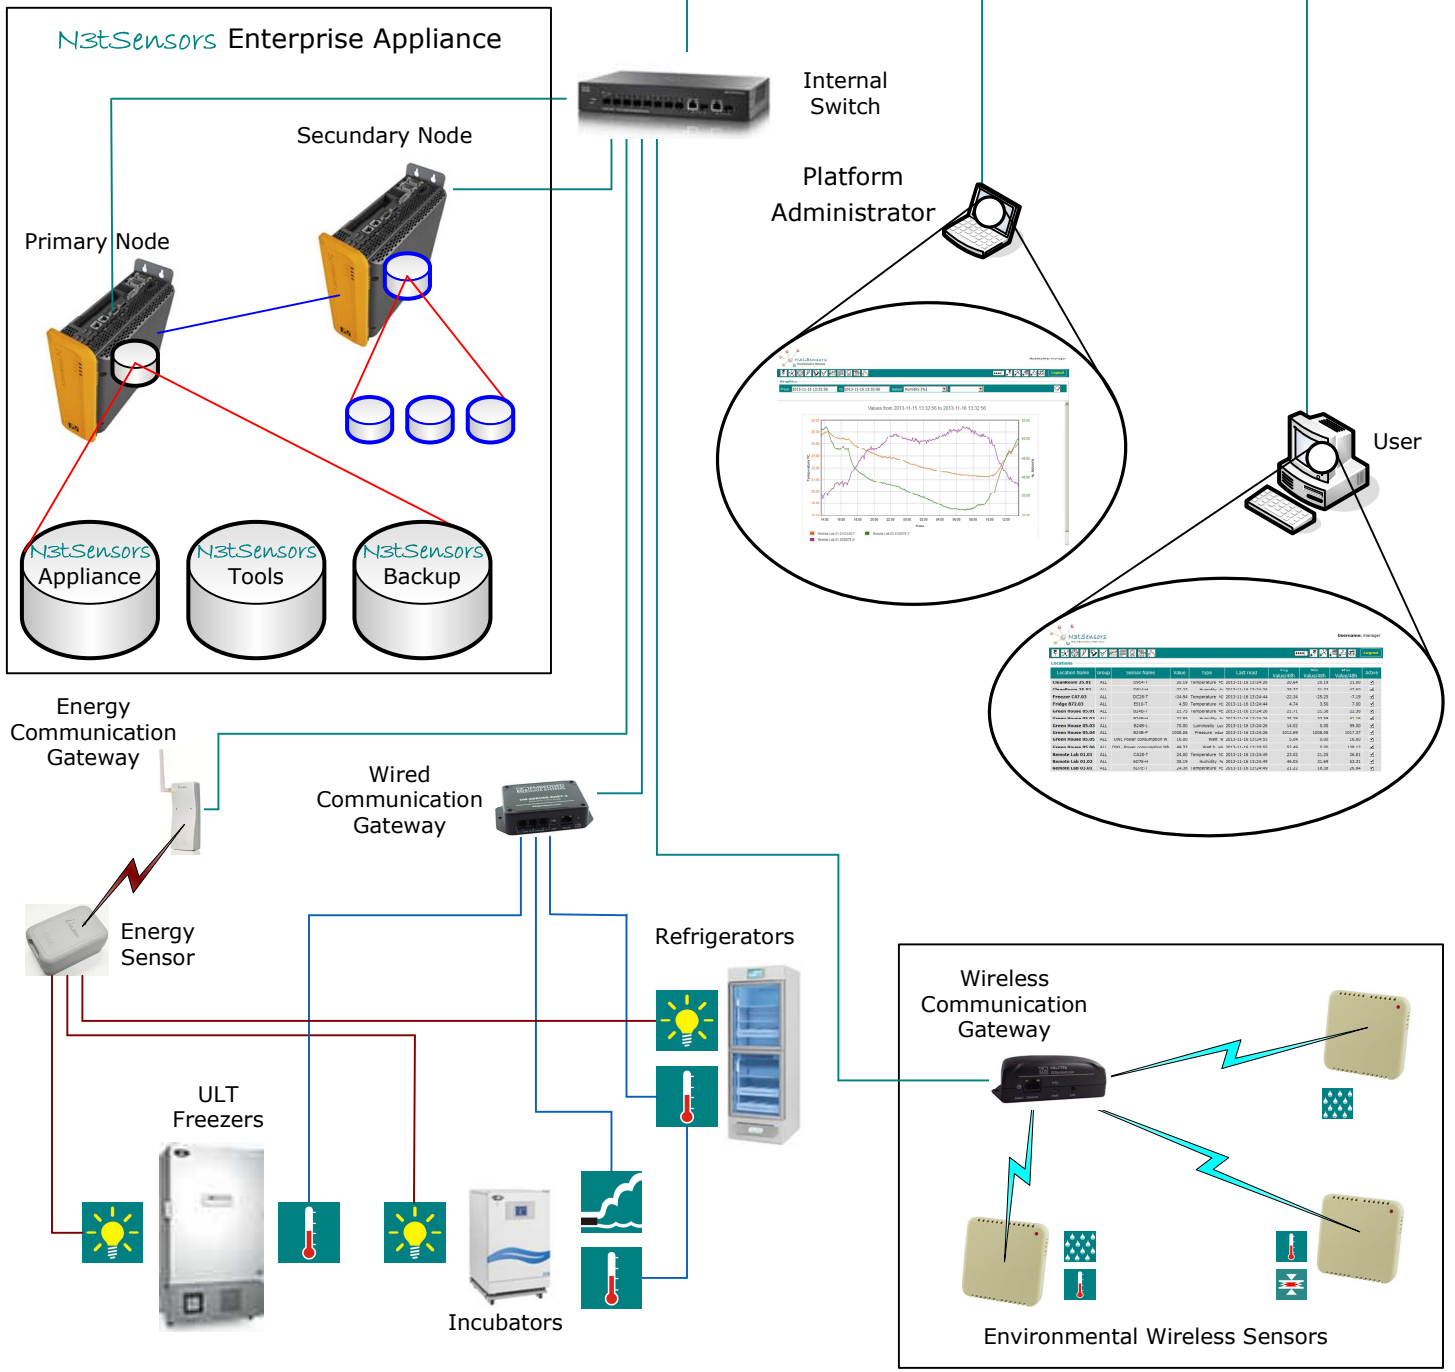

Location Name	Temp	Control Name	Alarm	Temp	Unit Name	Unit Name	Unit Name	Unit Name
Operating Room 01	FULL	OS01T	20.00	Temperature	20.00	20.00	20.00	20.00
Operating Room 02	FULL	OS02T	19.50	Temperature	19.50	19.50	19.50	19.50
Operating Room 03	FULL	OS03T	19.00	Temperature	19.00	19.00	19.00	19.00
Operating Room 04	FULL	OS04T	18.50	Temperature	18.50	18.50	18.50	18.50
Operating Room 05	FULL	OS05T	18.00	Temperature	18.00	18.00	18.00	18.00
Operating Room 06	FULL	OS06T	17.50	Temperature	17.50	17.50	17.50	17.50
Operating Room 07	FULL	OS07T	17.00	Temperature	17.00	17.00	17.00	17.00
Operating Room 08	FULL	OS08T	16.50	Temperature	16.50	16.50	16.50	16.50
Operating Room 09	FULL	OS09T	16.00	Temperature	16.00	16.00	16.00	16.00
Operating Room 10	FULL	OS10T	15.50	Temperature	15.50	15.50	15.50	15.50
Operating Room 11	FULL	OS11T	15.00	Temperature	15.00	15.00	15.00	15.00
Operating Room 12	FULL	OS12T	14.50	Temperature	14.50	14.50	14.50	14.50
Operating Room 13	FULL	OS13T	14.00	Temperature	14.00	14.00	14.00	14.00
Operating Room 14	FULL	OS14T	13.50	Temperature	13.50	13.50	13.50	13.50
Operating Room 15	FULL	OS15T	13.00	Temperature	13.00	13.00	13.00	13.00
Operating Room 16	FULL	OS16T	12.50	Temperature	12.50	12.50	12.50	12.50
Operating Room 17	FULL	OS17T	12.00	Temperature	12.00	12.00	12.00	12.00
Operating Room 18	FULL	OS18T	11.50	Temperature	11.50	11.50	11.50	11.50
Operating Room 19	FULL	OS19T	11.00	Temperature	11.00	11.00	11.00	11.00
Operating Room 20	FULL	OS20T	10.50	Temperature	10.50	10.50	10.50	10.50